




CITY OF CALGARY CORROSION RESISTANT SERVICE BOX

CCSB1

Please note that drawings are approximate and not to be used for engineering purposes – please contact us for specific dimensions.

CCSB2

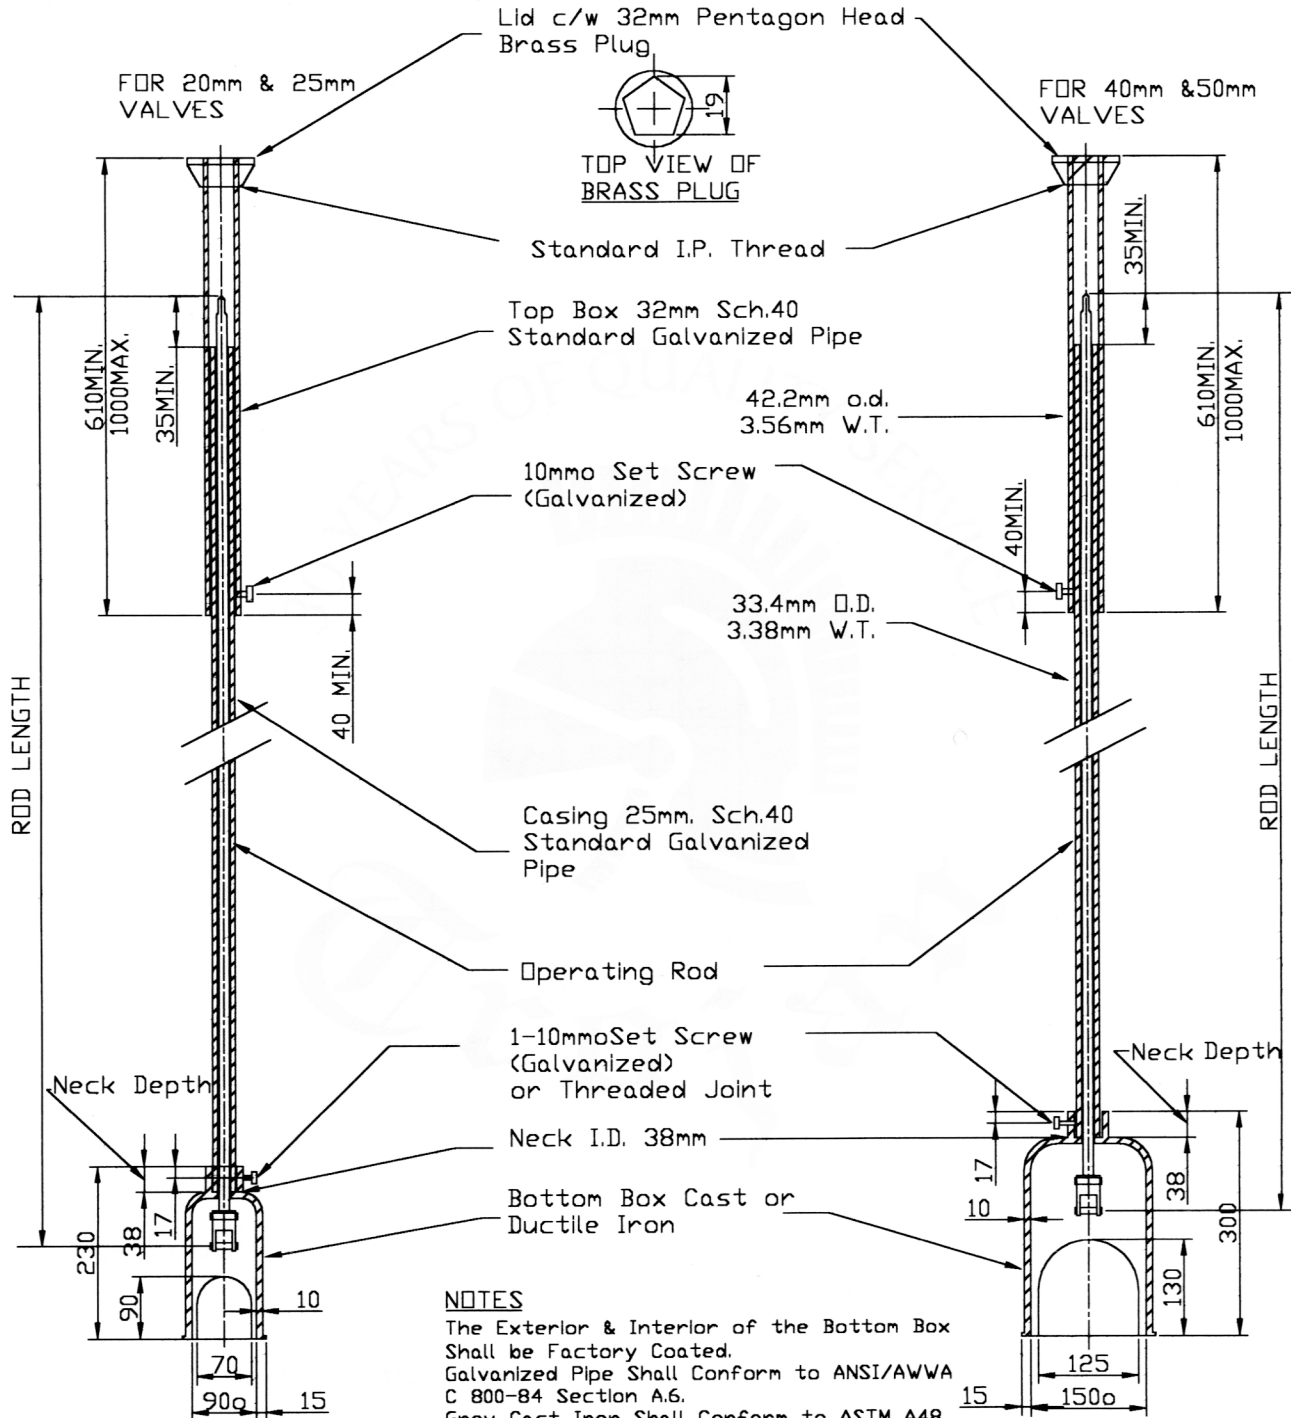

NOTES

The Exterior & Interior of the Bottom Box Shall be Factory Coated.
Galvanized Pipe Shall Conform to ANSI/AWWA C 800-84 Section A.6.
Grey Cast Iron Shall Conform to ASTM A48, Class 25 (Latest Edition).

**SMALL BOOT FOR
20mm & 25mm
SERVICE**

**LARGE BOOT FOR
40mm & 50mm
SERVICE**